



Comparison between the hours of operation of the heaters between 2 broiler houses (direct gasheaters of 85 kW)

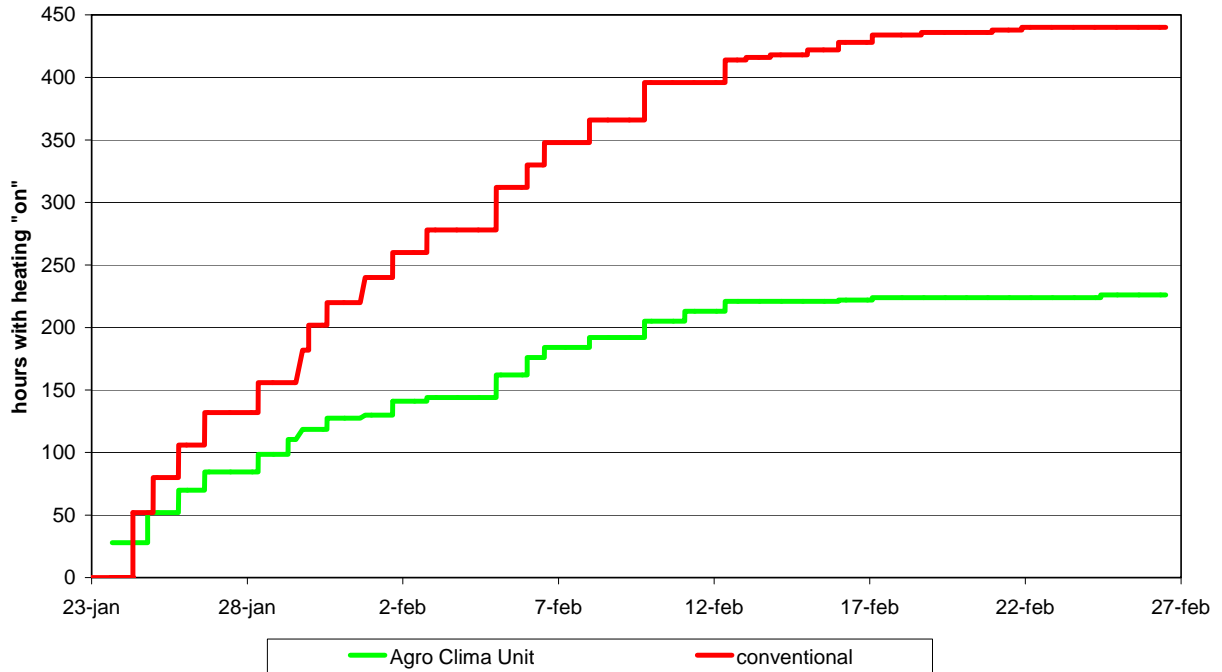


Measured temperatures

measured outside temperature is higher than the temperature of fresh air entering the Agro Clim Unit, the sensor was located between 2 warm houses

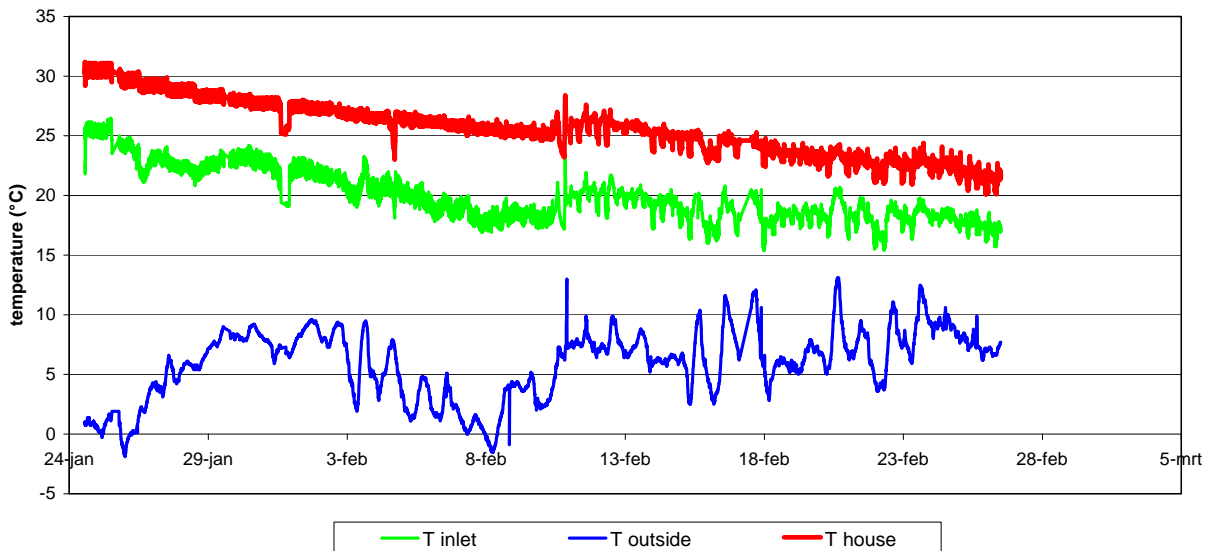

Comparison between the hours of operation of the heaters between 2 broiler houses (direct gasheaters of 85 kW)

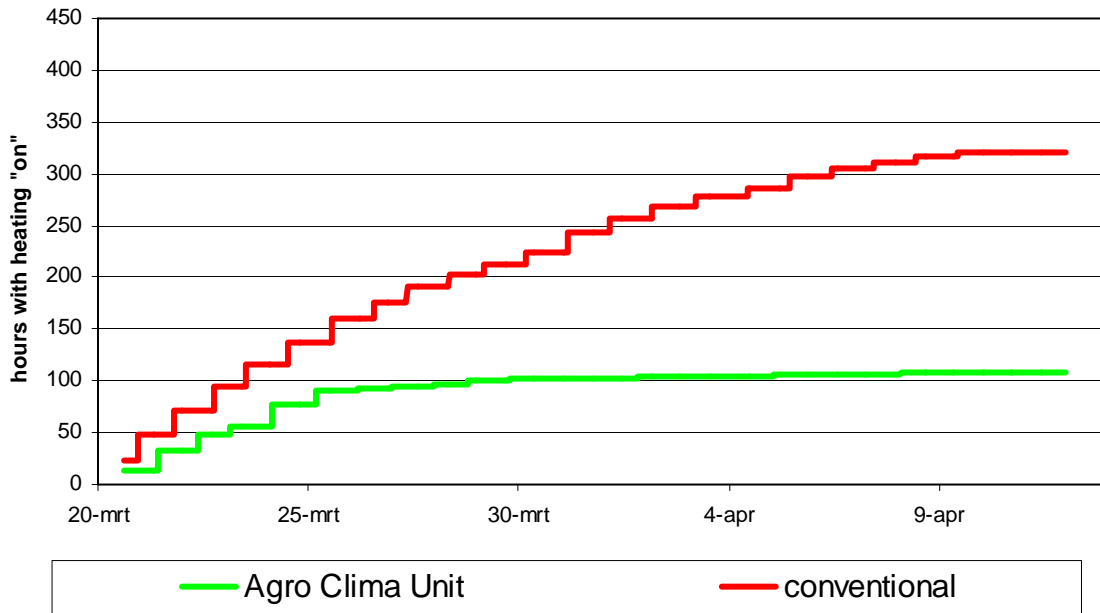

Measured temperatures
 measured outside temperature is higher than the temperature of fresh air entering the Agro Clima Unit, the sensor was located between 2 warm houses

